

MH Thermostatic Mixer - Installation cross-section


Key:

A: Minimum distance required from front face of finished wall (without fixing bracket *)
- 88mm (not including allowance for pipe-work connections)

B: Minimum distance required from front face of finished wall (with fixing bracket *)
- 93mm

C: Threaded tubes must protrude
20-25mm

D: Threaded tubes can be reduced
by up to 25mm maximum

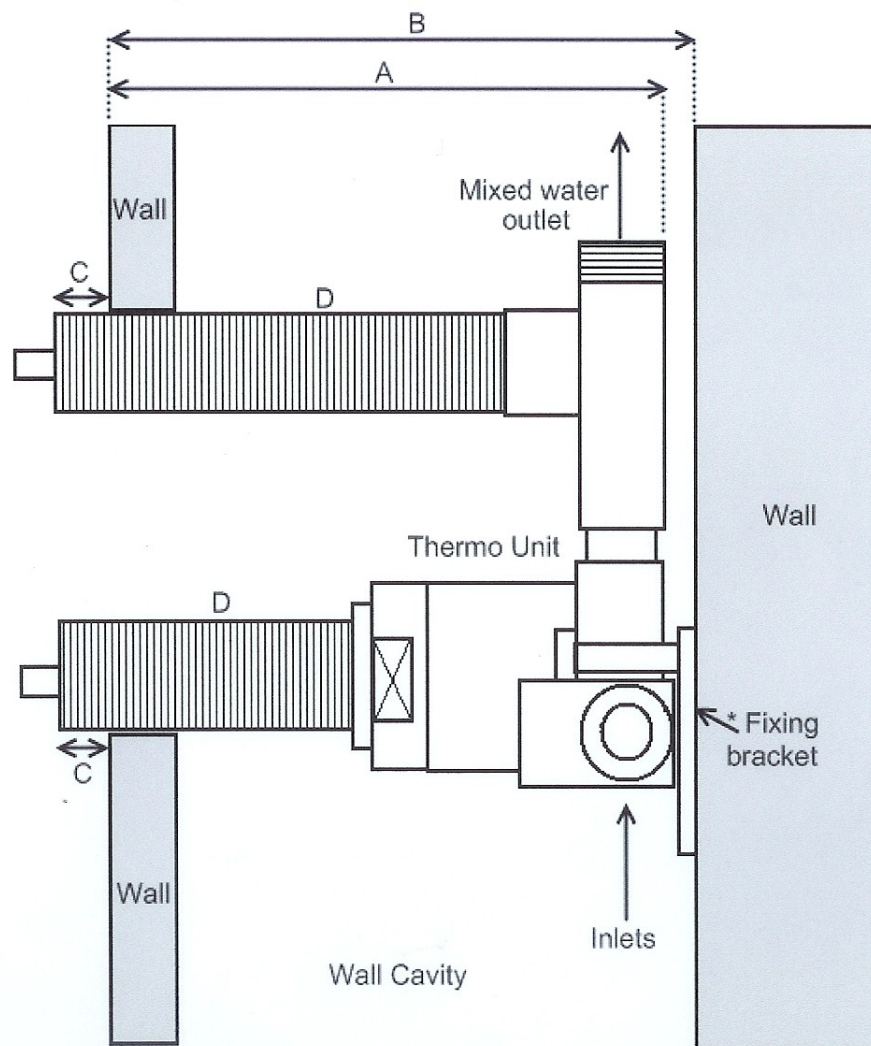

NOT TO SCALE

waterfront